

OFFICE OF THE EXECUTIVE ENGINEER
Electricity Distribution Division
DEOBAND

ESTIMATE

Name Shri. श्री सेठ पाल S/o Shri. श्री निरंजन
Village वीरपुर मापस P.O. वेडागुज Block नागाव
Load ३.५ HP (H.P.) Sanction No. १००-८२०-२६८३ Dated ०३/०९/२०२२

	Work Involved	Quantity	Rate Per	Amount (Rs.)
<u>14.603</u>	11 KV. lines on P.C.C. Poles	36 मी	Rs. 130/-	39227=
<u>14.603</u>	2 L.T. Line 3 phase on P.C.C. Poles	कोविस	130/-	
3	Extra Cost for section Poles (11 K.V. Line)	सर्विस	-	
4	Extra for last Pole tapping		-	
5	Extra for L.T. tapping		-	
6	Extra cost for 11 K.V. tapping		-	
	Total			39227=
<u>14.542</u>	1 11/0.4 K.V. Substation 10 KVA on PCC Pole structure	1	80,495/-	31527=
			94582	
<u>14.621</u>	1 Fixed Charges		7000/-	5000=
2	Variable Charges		5000	
3	System Loading Charges	K.V.A. 1270- Per K.V.A.	300	2400=
	Total			

JUNIOR ENGINEER
(33 KV) देवी प्रकाश
33/11 के 0 वी 0 उपकेंद्र

Sub-Divisional Officer
E.D.S.D. [Signature]

No. Dated

Copy forwarded to Divisional Engineer, Electricity Distribution Division-II, Saharanpur for information and necessary action.

ABSTRACT

14.630 Ch. to U.P.P.C.L. Rs.

14.542 Ch. to U.P.P.C.L. Rs.

14.621 Ch. to Consumer Rs.

14.603 Ch. to Consumer Rs.

Sub-Divisional Officer
E.D.S.D. [Signature]

Checked by

Allocation Checked

Estimate Sanction No.
Dated

TECHNICAL REPORT

SUMMARY OF MAIN MATERIAL REQUIRED

1. Length of H. T. Line proposed.....X.....Mts	1. Support.....
2. Length of L. T. Line proposed.....36 Mts.....	2. Conductor.....
3. Capacity proposed for new S/S.....X.....KVA	3. Stay Rod 16 MM.....
4. Capacity of existing S/S.....KVA	4. Stay wire 7/10 SWG.....
5. Total Connected load on S/S.....7.5 MHP	5. L.T. Shack Insulator 75 X 90 MM.....
6. Sanction load.....7.5 MHP.....HP	6. L.T. Pin Clamp.....
7. Feeder.....Beerpur Feeder.....	7. Stay Insulator.....
8. 33 KV/11/4 KV Sub-Station.....S/S.....Beerpur	8. Stay Clamps.....
	9. Earth Clamps.....
	10. Earth Wire (G.I. wire) 5 MM.....
	11. Earthing Rod 20 MM.....
	12. M.S. Bolts & Nuts.....
	13. P.V.C. Cable 4 X 6 MM.....
	14. 11 KV Pins & Insulator.....
	15. 11 KV Disc & Fittings.....
	16. M.S. Channel 100 X 50.....
	17. M.S. Angle 65 X 65 X 6 MM.....
	18. 11 KV X Arm.....
	19. U Clamps.....
	20. F Clamps.....
	21. Transformer.....
	22. P.V.C. Cable 4 X 6 MM.....
	23.....
	24.....

Note -> प्रस्तावित उपभोक्ता की उम्मीद लाइन बनाने में अगर कोई बाधा या रुकावट उत्पन्न होती है उसकी पूर्ण जिम्मेदारी उपभोक्ता की होगी न कि विद्युत विभाग की


Note -> चरेख नैकान सेंटरपाल 30 प्रखी न.स.नं- 312000144568

33/11KV S/S नीरपुर / नीरपुर मीर

ROUGH LINE CHART

प्रस्तावित सेंटरपाल की पिरधी गाम नीरपुर

36 मी. के छिटा सार्विस

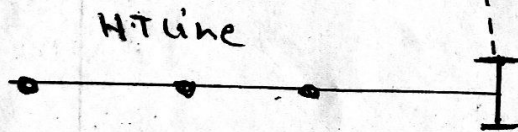

11KV
25KV
प्रखी डी.मालु
गाम नीरपुर मारुप
7.5MHP

उपभोक्ता अधिकारी
वि. वि. उपभोक्ता मण्डल

प्रताप सिंह (अवर अभियन्ता)

33/11के0वी0 उपकेन्द्र
खेड़ा मण्डल (देवगढ़)