


LINE CHART

6/26 PM to do Koshim Ward 71 work
No. Bchadg

Level - 9 HP 3 nos PM


Drop load - 5 HP PM 60 5 KVA

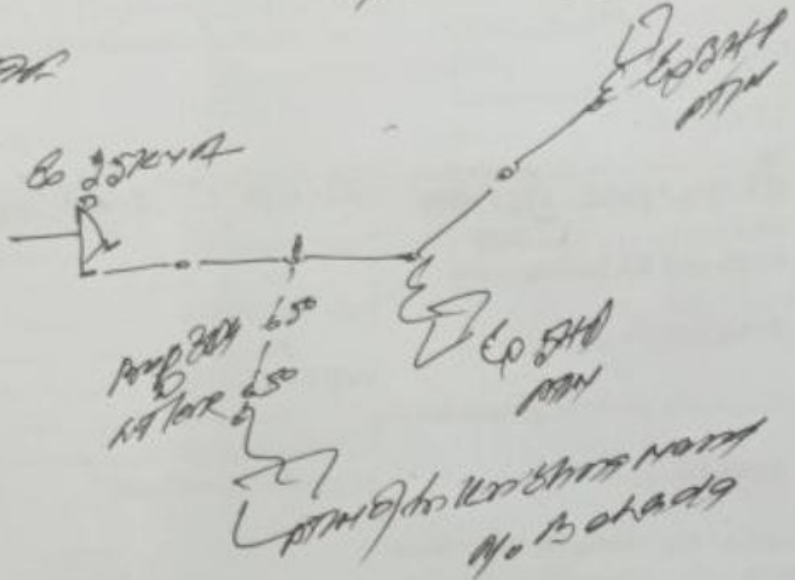

Requirement

- 1- P.C.C. pole 8.5 mtr..... 2No
 - 2- ACSR weasel conductor... 3.79mtr.
 - 3- GI wire SWG 12KG
 - 4- Stay rod..... 2No.
 - 5- Stay wire 7/10 swg..... 9KG
 - 6- Earthing Rod..... 1No
 - 7- T/F..... KVA..... 0No
 - 8- Length of line..... 100mtr 30mW
- ① MC cable 4/16 sqmm - 20 mtr
(Availability of conductor)

Voltage Drop Calculation

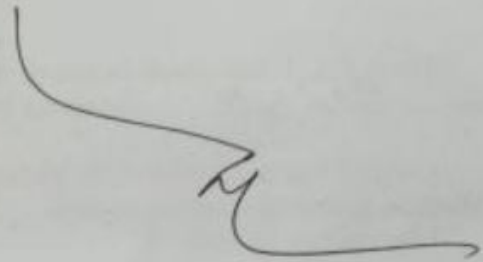

S.D.O.

Jr. Engineer