

ELECTRICITY DISTRIBUTION DIVISION RURAL KASGANJ

Estimate to issue a New Connection of 13 HP LMV5 for PTW to Sri Ramveer S% Sri Veersahay Village + Post - Badhola Block & Tehsil - Patiyali Kasganj as per Senction No. /2020-21 Against Letter No. 341 Date 14.06.2023 From EDD Rural Kasganj . Application No. 1008287718 Mob. No. 9027038746


ABSTRACT

Sl.No.	Particular	Charge to Consumer	Charge TO DVVNL
01	Cost of 11 kv Line Support	1,05,130	-----
02	Cost Of 11 Kv Double Pole Support	1,09,412	
03	Meter cost		-----
04	Total Amount	2,14,542	
05	GST @ 18%		
06	Security		
Total		2,14,542	NIL


(NEERAJ GAUR)

JE

33/11 KV S/S DARIYAVGANJ


(Rahul Singh)

S D O III

EDSD PATIYALI


EE

EDD RURAL KASGANJ

Line Chart

Estimate to issue a New Connection of 13 HP LMVS for PTW to Sri Ramveer S% Sri Veersahay Village + Post - Badhola Block & Tehsil - Patiyali Kasganj as per Senction No. /2020-21 Against Letter No. 341 Date 14.06.2023 From EDD Rural Kasganj . Application No. 1008287718 Mob. No. 9027038746

11KV MAIN LINE BADHOLA FEEDER

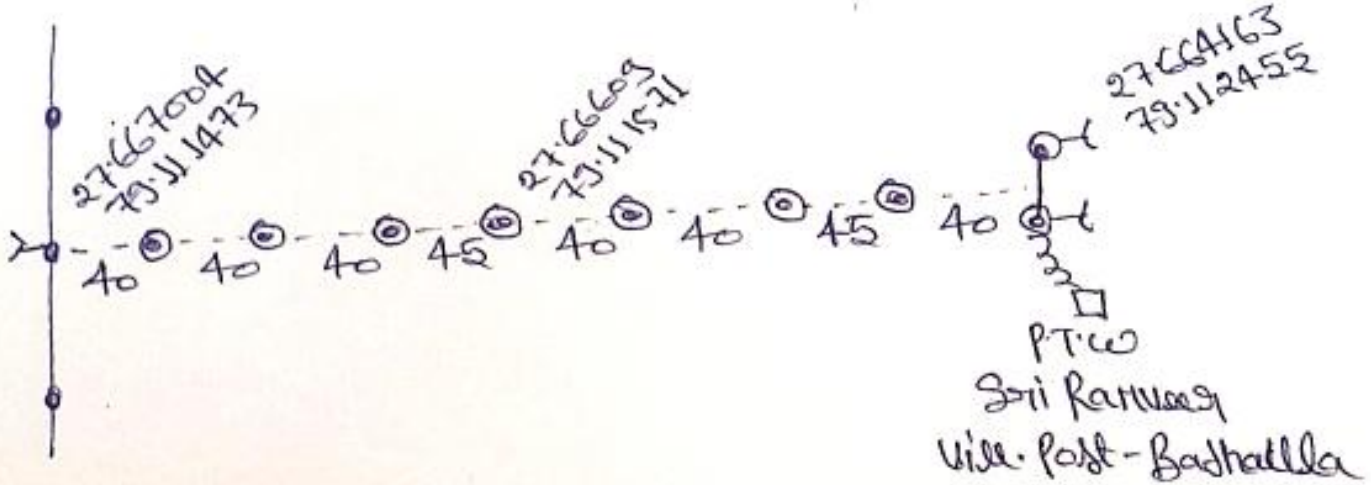

Proposed 11 KV Line Length 330 Mtr With Double Pole

Neeraj Gaur
(Neeraj Gaur)

J.E.

33/11KV S/S DARIYAVGANJ

Rahul Singh
(Rahul Singh)

S.D.O. III

E.D.S.D.PATIALI

E.E.

EDD RURAL KASGANJ

मेरे आवेदित निजी नलकूप की सर्वे मेरी मौजूदगी में की गई है प्रस्तावित लाइन निर्माण में किसी भी विवादित स्थिति मे लाइन बनाने की सम्पूर्ण जिम्मेदारी मेरी होगी।

21 मवी 2