

:- TECHNICAL REPORT :-

An Enclosed Estimate amounting to Rs. 1,78,123.60..... For the Estimate for the Given Supply 13 HP of Shri Hukum Singh S/O Shri Dal Chandra R/O Village Nagla Deshi Dist. Kasganj As Per Application No.1008289844 & Letter No 360 Dated 17-06-2023. The work will be Completed under supervision of Junior Engineer Concern 33/11 KV S/S Sahawar under SDO-IV Amanpur Kasganj the rate as per respo by UPPCI.

:-Line Chart :-

No of Pole. 08.


Total Distance- 255m.

नोट द्वारा निर्माण कार्य की पूर्ण जिम्मेदारी घेरी (हुकूम सिंह S/O दलचंद्र) की होगी इगलान्त निर्माण कार्य में कंविवाय-विवाद उत्पन्न हो सके तो उसका निराकरण मैं स्वयं करूंगा।

दिशामात्र

Proposed 11 KV Line.

Proposed STP 11 mtr Long.

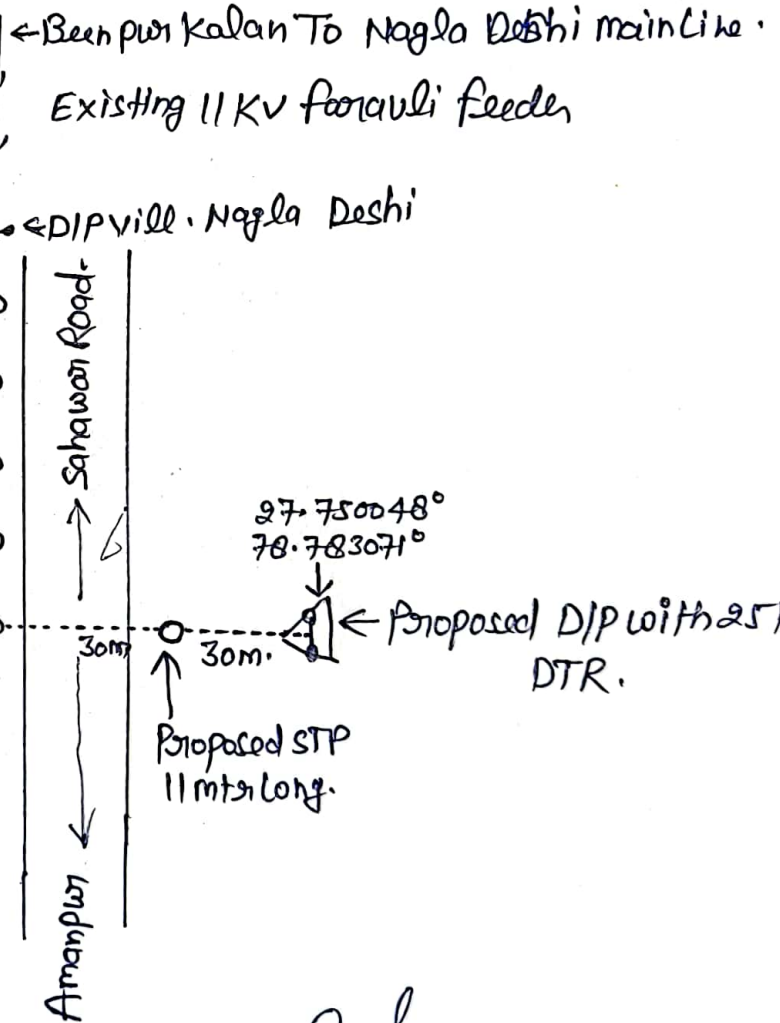

[Signature]
SDO

EDSD IV AMANPUR

[Signature]
JE

33/11KVS/S SAHAWAR