

306
30/06/2023

full Deposit
Aauls


Estimate

Electricity Distribution Division - 1st Bareilly

An estimate amounting to Rs. 144519=00 only has been framed to cover the cost for giving 8 HP PTW connection to the name of Shri Santa Agrawal or s/o Vipin Agrawal
 Village Aliganj Post Aliganj
 Block Mohangan Tehsil Aauls Distt Bareilly
 The line will be tapped from Pipriya Ag. feeder S/S
 Of village Amrauli emanating from 33/11 KV S/S Aliganj
 Load has been sanctioned vide O.M. 1000293233 Dated 21/06/2023

Line Chart

existing
11KV line
Pipriya Ag.

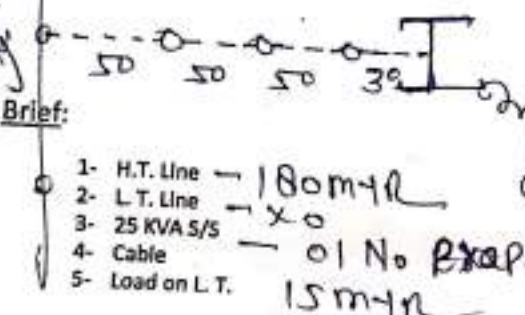

Brief:

- 1- H.T. Line - 180m
- 2- L.T. Line - 15m
- 3- 25 KVA S/S - 01 No Proposed New
- 4- Cable - 01 No Proposed New
- 5- Load on L.T. - 8 HP

New Connection Proposed
Santa Agrawal
Vipin Agrawal
Aliganj

ELECTRICITY DISTRIBUTION DIVISION
AOM/11-11/11/11/11/11

Sanctioned For Rs. 144519=00
 Rs. One lac forty four thousand five hundred nineteen only.
 Chargeable Head Deposit
 Chargeable To UPPCL Ltd. Nil
 SLNo. 306/500-11/11/11/11/11
2023-24

Certified that:

- 1- Connection is technically feasible.
- 2- Boring
- 3- Voltage drop is under permissible limit to consumer under consideration
- 4- Connection shall be released from existing/proposed transformer

Abstract of cost (As per cost data book 2015)

1- Line H.T.	180	Mtr. @ 236/-	42480=00
2- Line L.T.	15	Mtr. @	
3- Cost of 25 KVA S/S (1/3 or Full as the case may be)			94582=00
Total Rs.			137062=00
Subsidy allowed to consumer (max. 68000.00 only)			

- A. Subsidy chargeable to UPPCL
- B. Cost chargeable to consumer
- 1- Processing charges
 - 2- Fixed charges
 - 3- Cost after subsidy
 - 4- System loading charges @ Rs. 300.00/KW
 - 5- Security @ 300.00/HP

Rs. 100.00	4957
Rs. 5000.00	
Rs.	137062=00
Rs.	
Rs.	2400=00
Rs.	144419=00
Rs.	144519=00

Total (1 to 5)
Grand total (A+B)

J.E.
Bup

EST. NAME... P-110 EST NO. _____ JOB CARD _____
 NEW PTW SHRI/SMT. Santa Agaswari b/w/o Vipin Agaswari s/s Aliganj
 LENGTH OF LINE (HT/LT) 1.8 MTR W/O NO. _____ & DATE _____ INCREASING CAPACITY _____ KVA TO _____ KVA COMPLETION DAY _____

S. NO.	ITEMS DESCRIPTION	ITEMS CODE	UNIT CODE	ESTIMATE QUANTITY		QUANTITY ISSUED/RETURNED				NET QUANTITY ISSUED
				ORIGINAL	REVISED	ISSUE NO. DATE	ISSUE NO. DATE	ISSUE NO. DATE	ISSUE NO. DATE	
1	PCC poles 8.5 mtr long	NO.	05							
2	ACSR Weasel conductor	Mtr.	560							
3	25 KVA T/F	NO.	01							
4	T-Off Channel	NO.	01							
5	Top Channel	NO.	01							
6	S/S Base angle	NO.	02							
7	11 KV cross arm	NO.	03							
8	Stay Set	NO.	02							
9	Stay clamp	NO.	02							
10	T-off Channel Clamp	NO.	02							
11	Top Channel Clamp	NO.	02							
12	11 KV X- Arms clamp	NO.	03							
13	F-Clamp	NO.	03							
14	11 KV Pin Insulator Complete	NO.	12							
15	11 KV Disc Insulator	NO.	86							
16	11 KV Disc fitting	NO.	06							
17	Earthing Rod	NO.	01							
18	Earthing wire 6 SWG	KG.	10							
19	Stay Wire 10 SWG	KG.	10							
20	L.T. Insulator	NO.	1							
21	L.T. Clamp	NO.	1							
22										
23	<u>TRMO sep</u>									
24										
25										

NAME OF ESTIMATE.....

DIV. NAME EDD-1 BLY.

E.E.

SIG. & SEAL.....

P-110
S.No. = 1

SIG. & SEAL.....

NAME OF CONSUMER.....

SUB DIVISION AONLA BLY.

[Signature]
I.E.

SIG. & SEAL S/S Aliganj

सहमति पत्र

9997234365

जिला अधिकारी कार्यालय के कार्यालय पत्रांक-5783/दिनांक-18/विक्रम दिनांक 08-10-2018 के अनुसूचन में।
(यह सहमति पत्र प्रत्यक्ष के साथ प्रस्तुत किया जाना है।)

सं. समता का हुना / पुत्र श्री W/ विपिन अग्रवाल, अजीवाड़ा पोस्ट किं गडा
जिला जौहला जिला जौहली कोन नं. के निजी मलबूज की प्रस्तावित नई
विद्युत लाइन के मार्ग हेतु सहमति पत्र। 9719119965


अभिप्रायी अधिकारी,
विद्युत विवरण संचालक,
(जौहला)

मेरे संयोजन कर्तव्यमान का विद्युत मार आपके कार्यालय पत्रांक दिनांक द्वारा स्वीकृत है।
मेरे भवन के मुख्य लाइन की दूरी मीटर है। मेरी मीटर एसटीओ व मीटर एकमीटर लाइन
जमायी जानी है एवं 25 किलोवाट पर परिवर्तित लगाया जाना आवश्यक है। क्योंकि मेरे मलबूज के पास कोई अन्य परिवर्तित
मशी है। मे परिवर्तित का पूरी व्यवस्था देने के लिए सहमत है। यह लाइन की पुत्र श्री
पुत्र श्री के खेत से होकर गुजर रही है।

प्रस्तावित विद्युत लाइन मार्ग के निर्माण में व भूमि पर यदि विवाद होता है तो इसकी पूरी जिम्मेदारी मेरी होगी एवं
प्रस्तावित लाइन का कोई अन्य नया मार्ग निर्धारित होता है, जिसमें अतिरिक्त लाइन सामग्री की जरूरत होती है तो उचित
मूल्य मेरे द्वारा वहन किया जायेगा। लाइन किसी विवाद के कारण नहीं बनती है, तो मेरा कर्तव्यमान निरस्त होने पर मुझे कोई
प्रतिपादन नहीं होगी, इसके लिए मैं किसी भी प्रकार का मुआवजा नहीं मांगूंगा। प्रस्तावित लाइन का सहमतिपत्रक लाइन चार्ट
लगावत है।

प्रस्तावित लाइन चार्ट

Existing
11 KV
Main Line
Pipariya Ag.

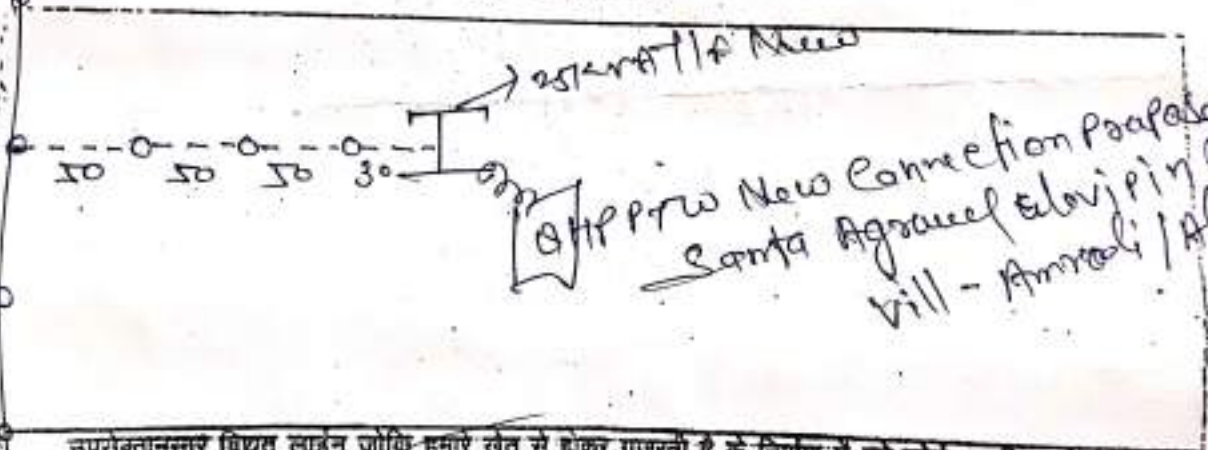

उपरोक्तानुसार विद्युत लाइन जोकि हमारे खेत से होकर गुजरती है के निर्माण में हमें कोई आपत्ति नहीं है
और हम इसकी सहमति देते हैं।

- | | | | | | | | | |
|----|------|---------|------------|---------|--------|----------|---------|------------|
| 1- | श्री | लालचन्द | पुत्र श्री | लालचन्द | निवासी | गामराड़ा | कोन नं. | 7011451738 |
| 2- | श्री | गोकुल | पुत्र श्री | राजेश | निवासी | | फोन नं. | |
| 3- | श्री | मौरादे | पुत्र श्री | लालचन्द | निवासी | | फोन नं. | 7060884042 |

आवेदक का नाम समत अग्रवाल
पता का नं. व कोन नं. 97593 49380

उपस्थित अधिकारी

हस्ताक्षर [Signature]
हस्ताक्षर [Signature]
अवर अभियन्ता [Signature]
Scanned by [Signature]