

Load Sanctioned No.

Dated:

Scheme: General/Cable/F.D

ELECTRICITY DISTRIBUTION DIVISION-BILASPUR

ESTIMATE FOR P.T.W/PUMP SETS

Name of Applicant

1. Sri/Smt. Sukhwant Singh & Bhagwan Singh
 2. Village: Beedha
 3. Block: Bilaspur

Village: Beedha

Code No.

Load of P.T.W. H.P.

Associated Light & Fan

Head	Detail of Line and S/S	Unit	Qty.	Rate Rs.	Amount
2061003	11 KV Line of PCC Pole with ACSR to Board	KM			
	Weasel C.H. to Consumer	KM.			
	L.T. Line 3 PH. 4 Wire on P.C.C. to Board	KM.			
	With A.C.S.R C.H. to Consumer	KM.			
2060302	Now S/S 11/0.4 KV.....100 KVA or increasing capacity of Existing S/S fromKVA toKVA.	No.		32110/-	32110/-
2060302	System Loading Charges	I.S.		100	100/-
020611	Fixed Charges for Service Line type A/B/C Chargeable to Board	Each			
020611	Fixed Charges for Service Line type A/B/C Chargeable to Consumer	Each		5000	5000/-
020611	Varible Charges for Bare Condutor CH to Consumer.	Mtr.		2400	2400/-
	Varible Charges for Cable Condutor CH to Consumer.	Mtr.		2400	2400/-
1- Total Amount Chargeable to Board Rs.....	Total.....				
2- Total Amount Chargeable to Consumer Rs.....					

REPORT

This estimate amounting Rs. 32110/- only has been framed to cover the cost & G.S. to P.T.W. The 11 KV Line will be tapped from Ramburा.....feeder emanating from 32111.....KV S/S A. Nagar. The load on existing 100 KVA Transformer is 7.5 H.P. or there is no existing T/F from which the load of prospective consumer can be connected. IN the estimate a new Sub-Station ofKVA have been proposed/increasing capacity of existingKVA T/F has been proposed to be increased byKVA T/F.

- Certified that estimate has been framed as per latest rate shedule of U.P.P.C.L.
- The proposed site of P.T.W. is beyond 200 m from S.T.W. No.
- The poposed site of P.T.W. is beyond 100 m from canal havning top with 25 feet
- Certified that the connection shall not be given from S.T.W. Transformer.
- The boaring of prospective Consumer Exist.

✓ Yes/No
✓ Yes/No.


Junior Engineer

Ramburा
feeder

Sub-Divisional Officer

Sanctioned of Rs.....

Ch. Head	Ch. To Cons.	Ch. To Crop.	Total
O/H			
S/S			
M/E			
Inspection Fee			
System loading			
Total			
Sanc. No.			

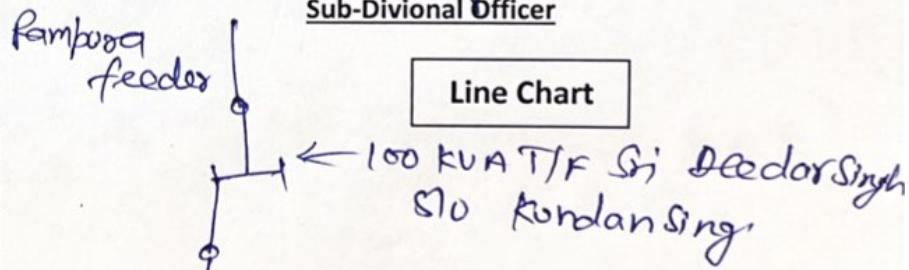

D/MAN

D.A.(W)

EE.

7.5HP
(SOD)

Proposed cable connection
to P.T.W. of Sukhdev
& Bajirao