


:- TECHNICAL REPORT :-

An Enclosed Estimate amounting to Rs. 2,14,359=94 For the Estimate for the Given Supply 13 HP of Shri Deewan Singh S/O Shri Sonpal R/O Village Itwarpur Dist. Kasganj As Per Application No.1008325752 & Letter No 583 Dated 21-09-2023. The work will be Completed under supervision of Junior Engineer Concern 33/11 KV S/S Sahawar under SDO-IV Amanpur Kasganj the rate as per respo by UPPCL.

No of Pole Pic 8.5m Long - 11
roof pole STP 11m. Long - 01
Total Distance - 470m.

नोट- लाइन निर्माण कार्य की पूर्ण जिम्मेदारी मेरी (देवान सिंह S/O सोनपाल) की होगी अगर लाइन निर्माण कार्य में कोई वाद-विवाद उत्पन्न होता है तो उसका निराकरण मैं स्वयं करूंगा।

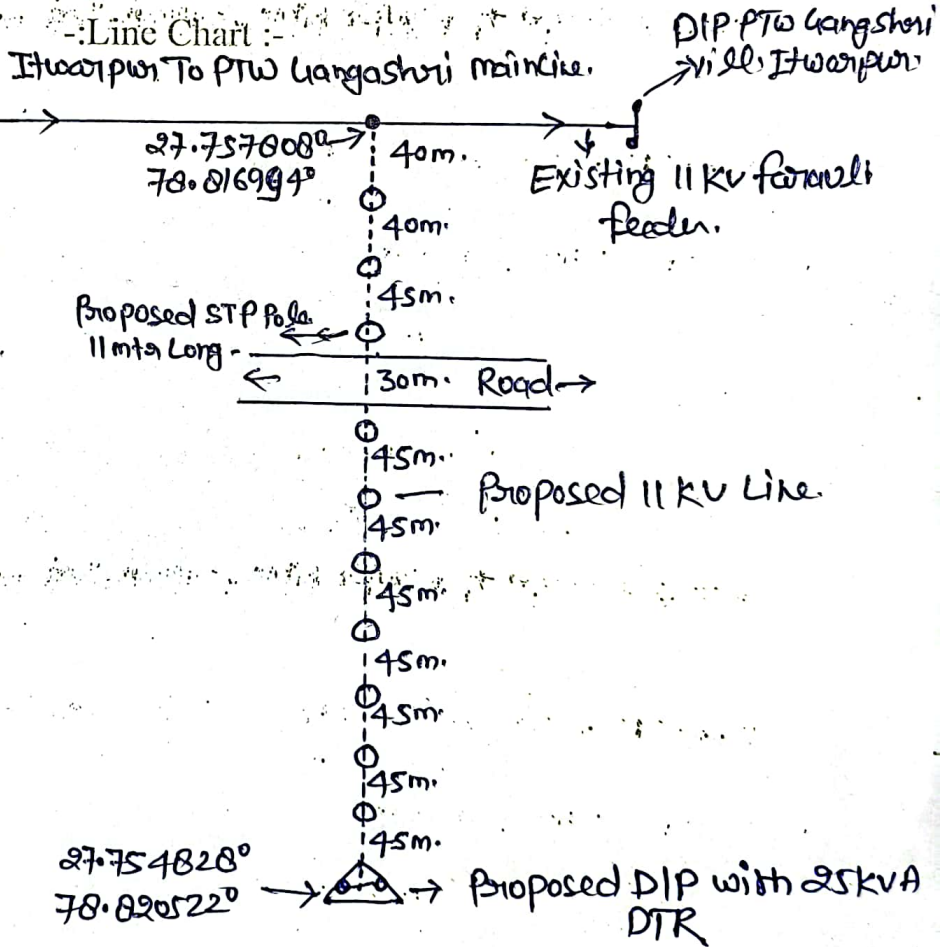

SDO
EDSD IV AMANPUR

JE
33/11 KVS/S SAHAWAR