


क्षी किशोरी लाल ५/६८ परमाइलल  
ग्राम - मारवडा, पोखर - नंदेला  
7017984702

APP. - 1008329892 पत्रक - 14744  
दिनांक - 425/2023-24, D + 04/10/2023  
San. Load - 10 HP(LMV-5)

27.42689  
79, 14211

Line Chart

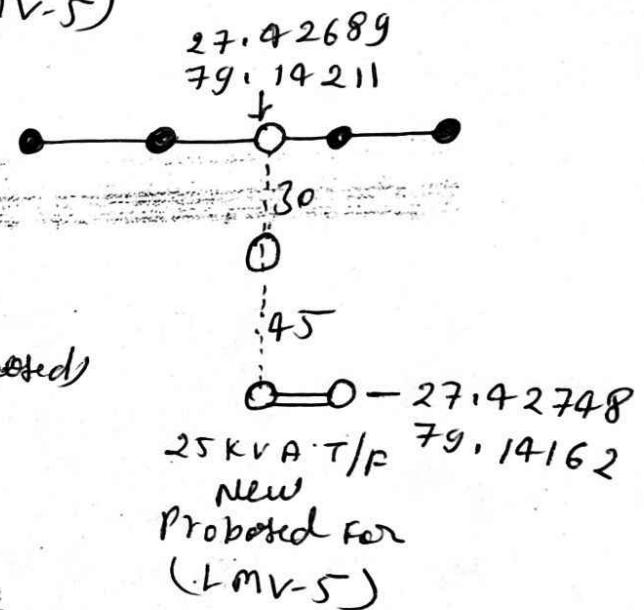

75

Mtr.

1. Length of HT Line Proposed	75	Mtr.
2. Length of Existing HT Line		Mtr.
3. Capacity of proposed new Sub Station	25	KVA
4. Capacity of existing S/S -		KVA
5. Total Connected load on S/S -		KVA
6. Proposed capacity after increasing -		KVA
7. Sanctioned Load -	10	HP.
8. Distance of consumer site from Store -	65	Km.

Certified That :-

- The power loss and voltage drop has been calculated and found to be within permissible limit.
- The site of tubewell line beyond/within ..... meters of main canal and ..... meter from other canal.
- The site of tubewell lines beyond /within ..... meters of nearest existing /Constructed State Tubewell.
- All the consumers connected to the sub -station have been shown in

### TFR

APP. - 1008329892

HT Line - 75 Mtr. Proposed

11 KV Feeder - Dhatingra

San. Load - 10 HP(LMV-5)

T/F Cap. - 25 KVA New T/K  
Probated

S/S - Jafrathpur

Gummar

Gummar  
J.K.