


Single Line Diagram showing the arrangement with details for giving supply to
 Shri. Mahandou Sto. W/O Radheshyam APPENDIX - 4
 Sheet No 5
 Village Jaran P. O. Jaran

Sl.	Particulars	Unit No.	Rate	Qty.	Ch. to Corp.	Ch. to Consumer
1.	I. C. Cut out	No.				
	(a) 30 Amp	No.				
	(b) 15 Amp	No.				
2.	Fixed Charges for PTW for Industrial	No.	4957	1		4957
	PVC Cable Size - 4 x 6 / 4 x 16	M		1		
	Variable charge			15m		
	System loading charges	KVA				
	KWH meter 3 Ph.x4W	No.				
	xx.....Amp.	No.				
	Earthing of Meter	L.S.				
	Labour for Installation of Meter	L.S.				

3% Contegency
 1.5% T & P+31.5% O.H. Charges= 33%

Total Rs. 4957
 Rs.
 G. Total Rs. 4957
 Say Rs. 4957

LINE CHART

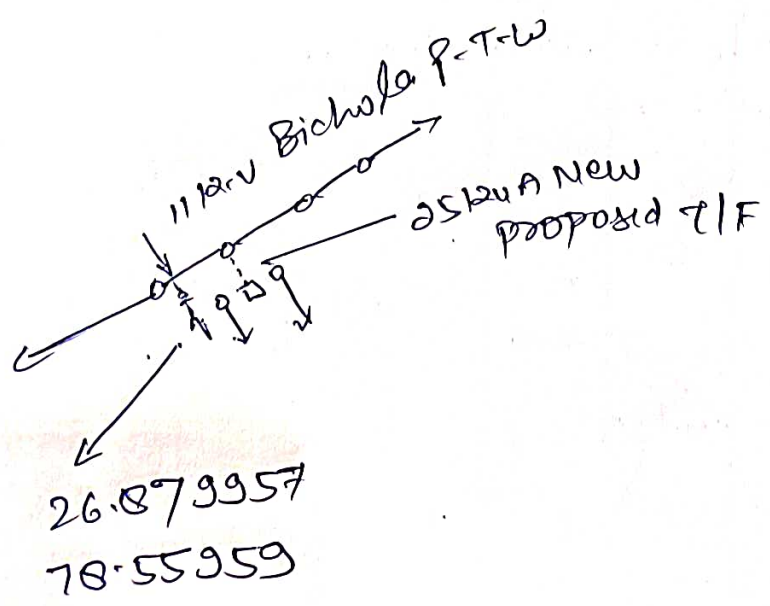

- | | | | |
|--|-------|---|-------|
| 1. Length of H. T./L. T. Line | | 5. Existing load on S/S | |
| 2. No. of Support PCC Pole 8.5 mt long | | 6. Existing Consumers | |
| 3. Capacity Existing T/F | | 7. Proposed loads | |
| 4. Capacity of Proposed T/F | | 8. Existing phase conductor on the exiting L.T./H. T. Line..... | |

[Signature]
 Jr. Engineer

S.D.O.

Executive Engineer