



कार्यालय
उपखण्ड अधिकारी
विद्युत वितरण उपखण्ड (चिलबिला)
प्रतापगढ़ (उ०प्र०)

पत्रांक / C 6711

/वि०वि०उपखण्ड चिलबिला प्रता० /

दिनांक: 24/11/23

विषय:- आवेदक द्वारा एल०एम०वी०-5 श्रेणी के अन्तर्गत स्थायी संयोजन विद्युत भार ०.3 हा०पा० की स्वीकृति हेतु तकनीकी आख्या प्रस्तुत के सम्बन्ध में।


अधिशाली अभियन्ता
विद्युत वितरण खण्ड-प्रथम
जनपद-प्रतापगढ़।


कृपया उपरोक्त विषयक में / श्री अकिशोरा सुत श्री कृष्ण प्रताप सिंह

पता व ग्राम (मजरा) जोगीपुर पोस्ट- जोगीपुर जनपद-प्रतापगढ़ के
बिन्दुकर (TFR/SIR) निम्नवत है:- APP-1008339830

01	आवेदित परिसर पर पूर्व में बकाये की स्थिति का विवरण।	नही
02	आवेदित परिसर पर पूर्व में कोई संयोजन का पूर्ण विवरण।	नही
03	परिसर की निकटतम H.T/L.T मेंस से न्यूनतम दूरी।	35 मी०
04	वितरण परिवर्तक के अतिभारित की स्थिति	अतिभारित नहीं
05	11KV पोषक के अतिभारित की स्थिति।	अतिभारित नहीं
06	33/11 KV उपकेन्द्र के पॉवर परिवर्तक की स्थिति।	अतिभारित नहीं
07	मीटर स्थापन हेतु परिसर पर उपलब्ध स्थान की स्थिति।	उपलब्ध
08	परिसर पर संयोजन का प्रयोग (वाणि०/कृषि/ आवासीय/अन्य)।	कृषि
09	परिसर पर निर्मित भवन का विवरण (एकल/बहु)।	एकल भवन
10	अन्य तकनीकी आख्या।	

सूचनार्थ एवं आवश्यक कार्यवाही हेतु प्रेषित।


अवर अभियन्ता
चिलबिला


उपखण्ड अधिकारी
विद्युत वितरण उपखण्ड चिलबिला
प्रतापगढ़

Electricity Distribution Division, Pratapgarh

P. No.

ESTIMATE

(2023)

Estimate framed by S.D.O I, II, III, IV

supply to Shri. Abhishekh for giving
 village Jogipur S/O chilbila
 District Pratapgarh Post Jogipur Block Mangrampur
 Load 03HP /HP PTW

Works Involved	Unit Cost	Total
1- 11 KV line.....KM	@ Rs. P/K.M.	Rs.
onsupports	Vide Shedule No.	Rs.
2- I.T line 3 phase.....KM	@ Rs. P/K.M.	Rs.
onsupports	Vide Shedule No.	Rs.
3- Extra cost for Section poles	Rs.	Rs.
	Vide Shedule No.	Rs.
4- Extra cost for tree off	Rs.	Rs.
	Vide Shedule No.	Rs.
5- Extra cost for underground cossing	Rs.	Rs.
	Vide Shedule No.	Rs.
6- Extra for	As per details enclosed.	Rs.

Total Rs.

Length of line chageable to the BoardMeters
 Length of line chageable to the conMeters
 summers beyond free limit
 TotalMeters

7- (a) 11/4 KV Sub Station.....Rs.	Vide Shedule No.	Rs.
(b) Increasing capacity fromKVA toKVA	Vide Shedule No.	Rs.
Cost of Service Line as per detail enclosed.	Rs.	Rs.
(a) Meter Cost	Rs.	Rs. 872
(b) System Loading charges	Rs.	Rs. 468
(c) Fixed Charges	Rs.	Rs. 900
(d) Securty Charges	Rs.	Rs. 900
Grand Total Rs.		2240

The H.T./L.T. iine would be tapped from East feeder sub-station in
 village Jogipur emanating from 132/33/11 KV Sub-station at chilbila

Certified that the costing of the works involved has been done according to Standard schedules framed in
 Division on current stock issue rates.
 Line chart on its back.

Senior Engineer
 Checked by- [Signature]

Allocation Checked

[Signature]

Sub-Divisional Officer
 Estimate Sanctioned
 No.

Man/Tech.Asstt.

Divisional Accountant (works)


...../of date

Copy to :-
 Sub-Divisional Officer
 Divisional Accountant (W)
 Assistant Engineer (Store)

Executive Engineer

Executive Engineer

LINE CHART

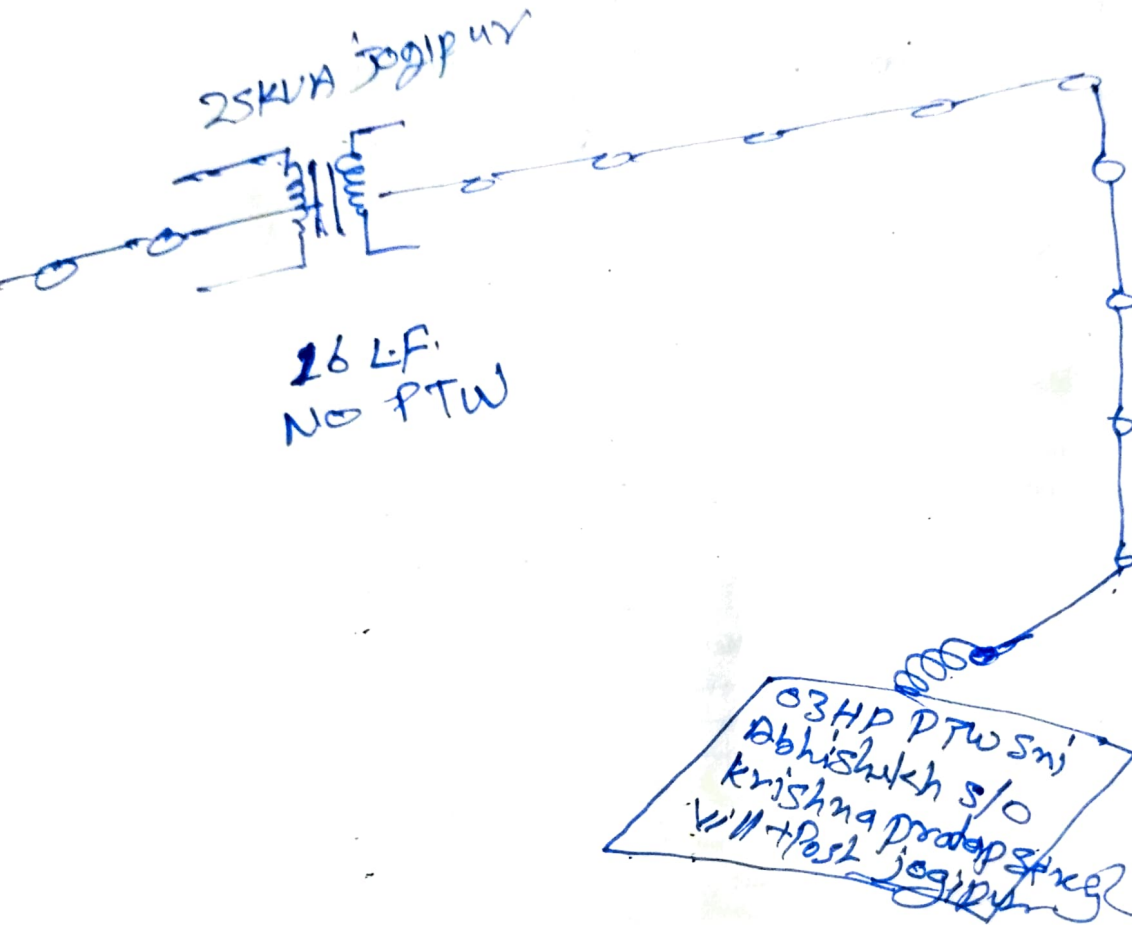

Voltage Drop Calculation

Requirement

- 1- P.C.C. pole 8.5 mtr.....No
- 2- ACSR wease! conductor.....mtr.
- 3- GI wire SWGKG
- 4- Stay rod.....No.
- 5- Stay wire 7/10 swg.....KG
- 6- Earthing Rod.....No
- 7- T/F.....KVA.....No
- 8- Length of line. 35 mtr lang Cable connection cable provide by consumer.....mtr

S.D.O.

Jr. Engineer