


Proposed line chart to give to Sri Narendra Singh  
 S/o Sri Sultan Singh Village Bhikkawala P.O. Khas Distt. Bijnor

DETAIL LINE CHART

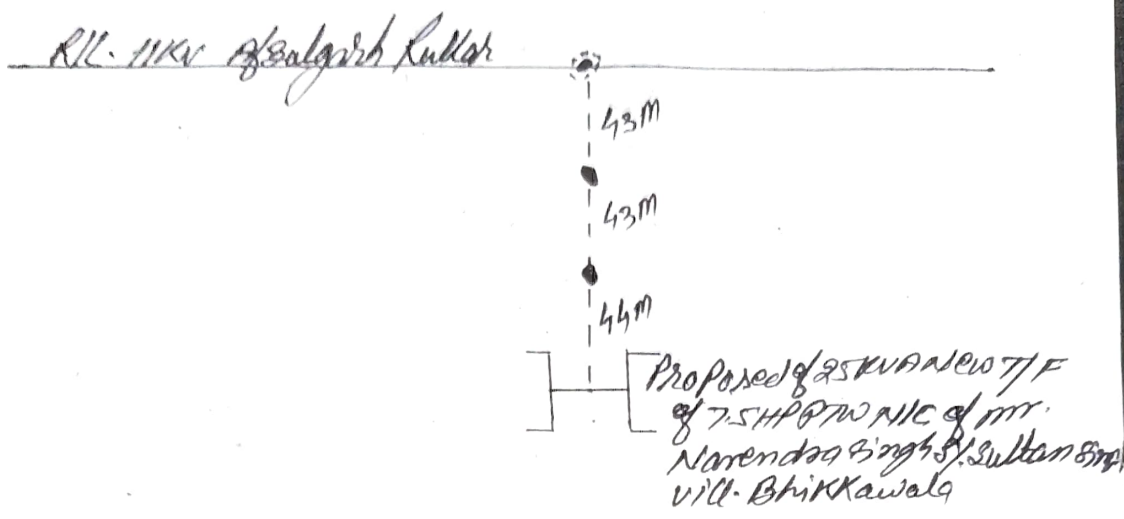

Surveyed by Sri Raj Kumar L/m. Samvida Line man/P/man

(A) List of material :-

1. PCC Pole 05 No.
2. ACSR weasal conductor 402 Mtr
3. 11 KV Disc with fitting 06 No.
4. 11 KV PIN insulator with pin 12 No.
5. Stay complete 03 No.
6. H T/F 25 KVA 01 No.
7. X Arm 11KV V. Type 03 No.
8. T. of. Channel 01 No.
9. Top Channel 01 No.
10. Dropper Channel 01 No.
11. S/S Angle T/F Box 02 No.
12. M/S. Earthing 02 No.
13. ....
14. ....
15. ....
16. ....

(B) Details :-

1. Length of line (a) HT 130 Meters  
 (b) LT ..... Meters
2. Existing of existing S/s ..... KVA
3. Existing Load ..... HP
4. Proposed Load 8 HP
5. Proposed capacity of S/s 25 KVA

Prepared by

C/S

Sarosh  
 Junior Engineer

Sub-Divisional Officer