

Single Line Diagram showing the arrangement with details for giving supply to

APPENDIX - 4
Sheet No. 5

Srnl. Chaturvedi Lal S/o. Vanshi Lal

Village Sarna P. O. Yaitpur

Sr.	Particulars	Unit Nos	Rate	Qty.	Ch. to Corp.	Ch. to Consumer
-----	-------------	----------	------	------	--------------	-----------------

- L.C. Cut out
 - (a) 30 Amp No.
 - (b) 15 Amp No.
- Fixed Charges for PTW for Industrial No. 1
- PVC Cable Size - 4 x 6 / 4 x 16 M 15m
- Variable charge
- System loading charges KVA
- KWH meter 3 Ph. x 4W
- X Amp. No.
- Earthing of Meter L.S.
- Labour for installation of Meter L.S.

4957 = 00

3% Contingency

1.5% T & P + 31.5% O.H. Charges = 33%


Total Rs.

4957 = 00

Rs.

G. Total Rs.

LINE CHART

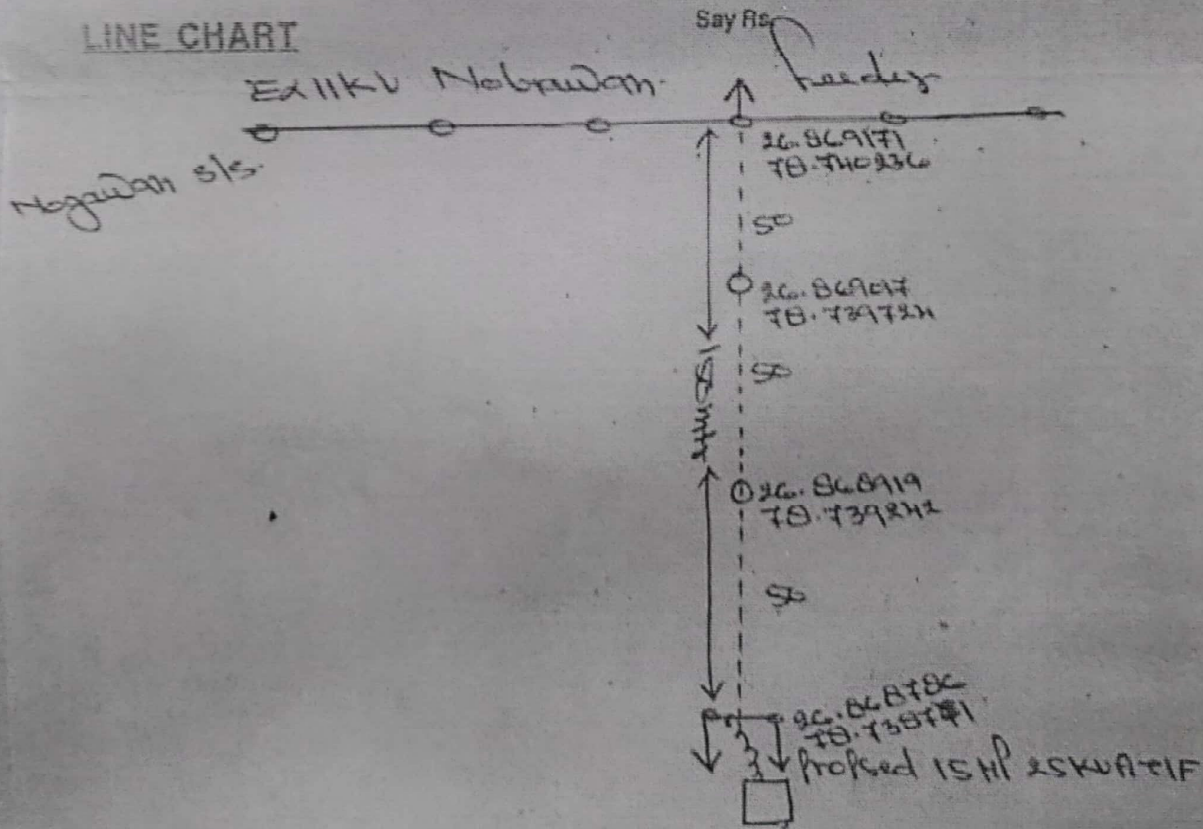

- Length of H. T./L. T. Line
- No. of Support (PCC Pole 8.5 mt long)
- Capacity Existing T/F
- Capacity of Proposed T/F
- Existing load on S/S
- Existing Consumers
- Proposed loads
- Existing phase conductor on the exiting L.T.H. T. Line

[Signature]
Jr. Engineer

[Signature]
S.D.O.

Executive Engineer