

दूरभाष न 9193330950

ईमेल:- eeedd2shamli@pvvn.org

ई-मेल/डाक/वाट्सऐप

⚡ राष्ट्रहित में बिजली बचाये ⚡



कार्यालय

अधिशाली अभियंता

पश्चिमांचल विद्युत वितरण निगम लि०

विद्युत वितरण खण्ड-द्वितीय शामली

निकट 33/11 के०वी० विद्युत उपकेन्द्र खेडीकरमू शामली

पत्रांक 6828 / वि० वि० ख० द्वि / शामली

दिनांक 9/11/2024

योजना : जमा योजना

विषय :- पी०टी०डब्लू पोर्टल पर प्राप्त आवेदन संख्या 1008364876 के सापेक्ष 10 अश्व शक्ति का नया निजी नलकूप संयोजन निर्गत करने के सम्बन्ध में।

सदाकत पुत्र रफीक

निवासी-ग्राम मलकपुर

जनपद-शामली।

महोदय,

कृपया उपरोक्त विषयक पी०टी०डब्लू पोर्टल पर प्राप्त आवेदन संख्या 1008364876 के सापेक्ष 33/11 के०वी० विद्युत उपकेन्द्र जसाला से पोषित 11 के०वी० पोषक फतेहपुर खेत से श्री सदाकत पुत्र रफीक निवासी-ग्राम मलकपुर जनपद-शामली को 10 अश्व शक्ति का निजी नलकूप विद्युत संयोजन निर्गत करने हेतु निम्नलिखित धनराशि जमा कराना आवश्यक है।

क्र०स०	विवरण	धनराशि
1	जमानत राशि	3000
2	सेवा संयोजन शुल्क	2036
3	3 फेस मीटर	2921
4	धनराशि जमा योजना के अन्तर्गत	47291
	योग रु०	55248

अतः आपसे निवेदन है कि उक्त धनराशि जमा कराने का कष्ट करे। धनराशि जमा होने के उपरान्त ही अग्रिम कार्यवाही की जा सकेगी।

नियम व शर्त:-

1. आवेदक को उक्त धनराशि आवेदित पी०टी०डब्लू पोर्टल पर ऑनलाईन माध्यम द्वारा जमा करानी होगी।
2. उक्त कार्य नियमानुसार जमा योजना के अन्तर्गत विभागीय नियमानुसार समस्त औपचारिकताएँ पूर्ण कराने के पश्चात ही कराया जायेगा।
3. उपभोक्ता को विद्युत आपूर्ति निर्धारित शैड्यूल के अनुसार दी जायेगी।
4. संयोजन निर्गत करते समय भूमि अथवा परिसर पर लाईन निर्माण करते समय होने वाले किसी वाद विवाद के लिये आवेदक स्वयं जिम्मेदार होगा निगम किसी भी प्रकार के वाद-विवाद के लिये जिम्मेदार नहीं होगा।
5. आर०ओ०डब्ल्यू० उपलब्ध कराने का दायित्व संबन्धित आवेदक/उपभोक्ता का होगा।

(नरेश कुमार)

अधिशाली अभियन्ता

9/11/2024

Office of the Sub-Divisional Officer E.D.S.D. II KANDHLA

PTW Application No. 1008364876

Name SADAKAT So/Wo RAFIQ
 Village Malakpur P.O. Kandhla Block Kandhla
 Load 10 H.P. Receipt No. 674 Date 03/01/2024

S.No.	Work Involved	Qty.	Standarded Rate In Rs	Amount(Rs.)	
				For 7.5 H.P	For 10.0 H.P
	Ch. To Consumer				
1	Conversion LT To HT Line (No. Of Pole)		@1000/-per pole	Rs.	Rs.
2	Constraction Of 11 Kv Line On Pcc Pole With Acsr WEASEL Conductor		@236/- per meter	Rs.	Rs.
3	Constraction Of LT Line 3 Phase With Pcc Pole With ACSR Weasel Conductor		@200/- per meter	Rs.	Rs.
4	Construction Of 11/0.4 Kv S/S 25 Kva On Pocc Pole Structure		94582/-	Rs.	Rs. 47291/-
5	I/C Of Existing S/S.....Kva To.....Kva			Rs.	Rs.
6	(i) 4X25 mm. Armoured PVC Cable With Catenary Arrangement	10 mtr	@213/-per meter	Rs. 2130	Rs. 2130
7	(ii) 3 Phase 4 Wire Static Meter 30-60 Amp. With Meter Box		2921/- per meter	Rs. 2921	Rs. 2921
8	(iii)System Loading Charges			Rs. -	Rs. -
9	(iv) Labour & Overhead Charges		₹ 2,036.00	Rs. 2036	Rs. 2036
10	Total Amount			Rs.	Rs.
11	Less Amount of Cable Shall Be Provided By Consumer		Less(-)	Rs. 2130	Rs. 2130
12	Net Amount Ch. To Consumer			Rs.	Rs.
13	Security		300/-per H.P	Rs. 2250	Rs. 3000
14	Total Estimated Amount			Rs.	Rs. 55248/-

(Sig. b=)
 Junior Engg./Incharge
 33/11 Kv S/S Taloda
 SAP 11000900

Head Fixed Deposit
 Estimate Sanction for Rs. 55248
 Ch. To Con. 55248
 Ch. To Corp. 55248
 Total: 55248

Entered In register at S.No. 71 / 2023 / 2024

Checked

D/MAN

DA(W)

Executive Eng.

No. 111 / Estimate/PTW

Copy forwarded to the Ex.Eng EDD-II Shamli for information and necessary action certified that the estimate has been prepared as priority

Dated 01/01/2024

500
 उपरि उल्लिखित कार्य के लिये
 प्रमाणित

Technical Report

1. Length of HT Line Proposed.....X.....km
2. Length of LT Line Proposed.....X.....km
3. Length of Existing LT Line.....X.....km
4. Capacity of Existing S/S.....100 kVA
5. Capacity Proposed for new S/S.....X.....KVA
6. Total Connected Load on S/S.....50.....HP
7. Proposed capacity after increased.....KVA
8. Sanctioned load.....10.....HP
9. Distance of consumer's Site from the nearest sub Division Store.....4.....K.m.
10. Name of 33/11 KV S/S.....Tasol
11. Name of 11 KV Feeder.....Fakirpur P.W.


Voltage drop Calculation

The tail point

HP X Km.

Summary of Main Material Require

1. Support (Pole).....
2. Conductor.....
3. Earth wire 6 gauge.....
4. Stay Wire.....
5. Pin Insulator With Pin.....
6. Disc Insulator with fitting.....
7. Stay Rods.....
8. Earth Rods.....
9. Cement.....
10. PV Cable.....
11. LT Clamp.....
12. Shackle Insulator.....
13. Nut & Bolt.....
14. 'V' Type X-arm.....
15. T/F.....
16. MS Channel.....
17. M.S. Angle.....

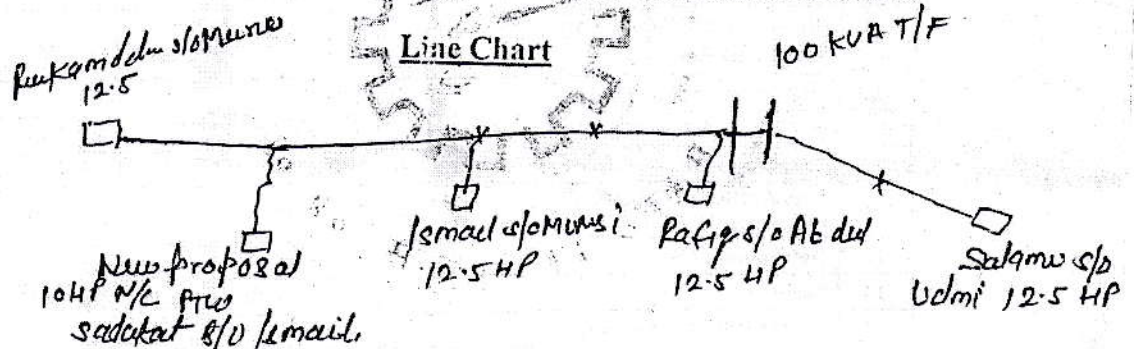

Total feasibility HP.Km.

Certified that:-

- 1- The Power loads and voltage drop has been calculated and found to be with in permissible limit
- 2- All the consumer to the Sub-station have been show in line chart
- 3- Boring is complited
- 4- Certified that the site of consumer has been parsonally inspected by me and above detailed material shall be exclusives & utilized for givien connection to this particulars consumer.it is also certified here was no connection previously in this check & no pending arrear on this connection
- 5- The double pole with HT Line proposed due to over loaded exist double pole & no LT Line exist near proposed connection.
- 6- The proposed double pole of 25 KVA is justified as per checking of site by me.

Sub-Division Officer
E.D.S.D-II KANDHLA

कायला अमिकारी द्वितीय
कायला

Jr.Engg./Incharge
33/11 kv S/S Tasol
SAP- 11000900