


01/2024 (AK) 949
09/01/2024

Estimate

Electricity Distribution Division - Aonla

An estimate amounting to Rs. 120919=00 only has been framed to cover the cost of giving 7.5 HP PTW connection to the name of Shri. Kali Charan W/O or S/O. Ser: Biddh. Sen
Village Bacheera Post. Ali Gremi
Block. Majhgawan Tehsil. Aonla Distt. Bux
The line will be tapped from 11KV Ali Gremi feeder S/S
Of village. Ali Gremi emanating from 33/11 KV S/S. Ali Gremi
Load has been sanctioned vide O.M. Dated.

Line Chart

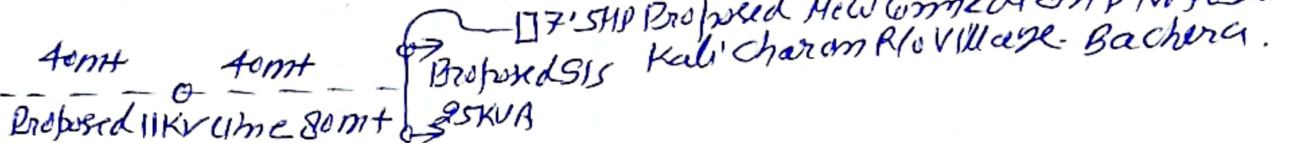

ELECTRICITY DISTRIBUTION DIVISION
AONLA

Brief: Existing 11KV line 11KV (Ali Gremi) Feeder

- 1- H.T. Line → 80mt
- 2- L.T. Line → NIL
- 3- 25 KVA S/S → 0/1/0
- 4- Cable → 20mt
- 5- Load on L.T. → 7.5HP

Sanctioned For Rs. 120919.00

Rs. One lac twenty thousand nine hundred nineteen only.

Chargeable Head. Deposite
Chargeable Price
Sl. No. 949/500 - II R. K. Ali
During the year 2023-24
Jogina
JELT

Certified that:

- 1- Connection is technically feasible.
- 2- Boring
- 3- Voltage drop is under permissible limit to consumer under consideration.
- 4- Connection shall be released from existing/proposed transformer.

Abstract of cost (As per cost data book 2016)

1- Line H.T.	00 Mtr. @ 236=00	= 18080=00
2- Line L.T.	Mtr. @	= 94582=00
3- Cost of 25 KVA S/S (1/3 or Full as the case may be)		113462=00
Total Rs.		

Subsidy allowed to consumer (max. 68000.00 only)

A. Subsidy chargeable to UPPCL	
B. <u>Cost chargeable to consumer</u>	
1- Processing charges	Rs. 100.00 100=00
2- Fixed charges	Rs. 5000.00 4957=00
3- Cost after subsidy	Rs.
4- System loading charges @ Rs. 300.00/KW	Rs.
5- Security @ 300.00/HP	Rs. 113462=00
Total (1 to 5)	Rs. 2400=00
Grand total (A + B)	Rs. 120919=00

S.D.O.
EDS D II Ind
Ali Gremi

J.E.
Ali Gremi

सहमति पत्र HT

(जिला अधिकारी बरेली के कार्यालय पत्रांक-5263/पीएच-16/विदिद्य दिनांक 06-10-2018 के अनुपालन में)
 (यह सहमति पत्र प्राक्कलन के साथ प्रस्तुत किया जाना है)


श्री. कालीचरण पुत्र श्री रामा कुचर ग्राम बचरा पोस्ट अलीगंज
 तहसील अलीगंज जिला बरेली फोन नं. 9809866925 के निजी नलकूप की प्रस्तावित नई
 विद्युत लाइन के मार्ग हेतु सहमति पत्र।

अधिरासी अभियन्ता,
 विद्युत वितरण खण्ड
 (अलीगंज)

मेरे संयोजन कनेक्शन का विद्युत भार आपके कार्यालय पत्रांक... दिनांक... द्वारा स्वीकृत है।
 मेरे नलकूप का मुख्य लाइन की दूरी 80 मी० है। मेरी HT/11KV मी० एल०टी० व... मी० एच०टी० लाइन
 बनायीं जानी हैं एवं 25 कं०पी०ए० का परिवर्तक लगाया जाना आवश्यक है। क्योंकि मेरे नलकूप के पास कोई अन्य परिवर्तक
 नहीं है। वे परिवर्तक का पूरी प्रमत्ति देने के लिए सहमत हैं। यह लाइन श्री... पुत्र श्री...
 के खेत से होकर गुजर रही है।

प्रस्तावित विद्युत लाइन मार्ग के निर्माण में व भूमि पर यदि विवाद होता है तो इसकी पूरी जिम्मेवारी मेरी होगी एवं
 प्रस्तावित लाइन का कोई अन्य नया मार्ग निर्धारित होता है, जिसमें अतिरिक्त लाइन सामग्री की जरूरत होती है तो उसका
 व्यय मेरे द्वारा वहन किया जायेगा। लाइन किसी विवाद के कारण नहीं बनती है तो मेरा कनेक्शन निरस्त होने पर मुझे कोई
 अपारिहारा नहीं होगी, इसके लिए मैं किसी भी प्रकार का मुआवजा नहीं मांगूंगा। प्रस्तावित लाइन का सहमतिपुक्त लाइन चार्ट
 निम्न है।

प्रस्तावित लाइन चार्ट

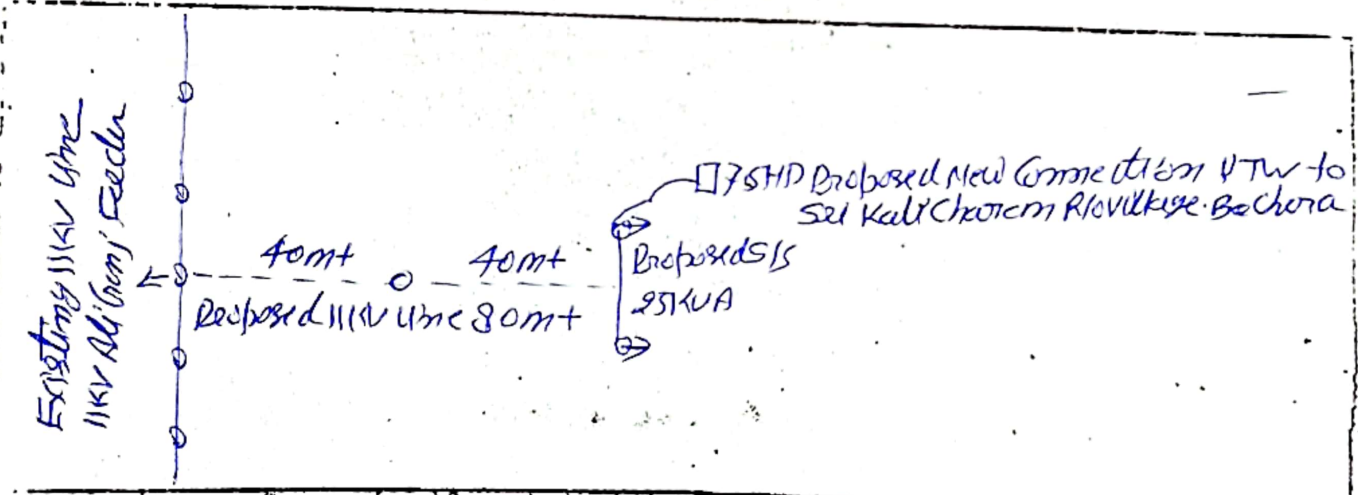

उपरोक्तानुसार विद्युत लाइन जोकि हमारे खेत से होकर गुजरती है के निर्माण में हमें कोई आपत्ति नहीं है
 और हम इसकी सहमति देते हैं।

- | | | | | | |
|----|----------------------|-----------------------------|--------------------|---------------------------|--------------------------|
| 1- | श्री. <u>कालीचरण</u> | पुत्र श्री <u>रामा कुचर</u> | निवासी <u>बचरा</u> | फोन नं. <u>9809866925</u> | हस्ताक्षर <u>कालीचरण</u> |
| 2- | श्री. <u>रामा</u> | पुत्र श्री | निवासी | फोन नं. | हस्ताक्षर |
| 3- | श्री. <u>रामा</u> | पुत्र श्री | निवासी | फोन नं. | हस्ताक्षर |

आवेदक का नाम कालीचरण
 पता का नं० व फोन नं०
 उपखण्ड अधिकारी दीप
अलीगंज

भारत खाला लम

हस्ताक्षर कालीचरण
 हस्ताक्षर
 अवर अभियन्ता
अलीगंज

EST. NAME PTW EST NO. JOB CARD S/S Al. Gannj
 NEW PTW SHRI/~~SWT~~ Kedi Chaitam S/O ~~PTW~~ Sri. Buddh Sen VILL Bachana PO Al. Gannj
 LENGTH OF LINE (HT/LT) 8.0 MTR W/O NO. & DATE INCREASING CAPACITY KVA TO KVA COMPLETION DAT.

S. NO.	ITEMS DESCRIPTION	ITEMS CODE	UNIT CODE	ESTIMATE QUANTITY		QUANTITY ISSUED/RETURNED			NET QUANTITY ISSUED
				ORIGINAL	REVISED	ISSUE NO. DATE	ISSUE NO. DATE	ISSUE NO. DATE	
1	PCC poles 8.5 mtr long	NO.		03					
2	ACSR Weasel conductor	Mtr.		250					
3	25 KVA T/F	NO.		01					
4	T-Off Channel	NO.		01					
5	Top Channel	NO.		01					
6	S/S Base angle	NO.		02					
7	11 KV cross arm	NO.		01					
8	Stay Set	NO.		03					
9	Stay clamp	NO.		03					
10	T-off Channel Clamp	NO.		01					
11	Top Channel Clamp	NO.		02					
12	11 KV X-Arms clamp	NO.		01					
13	F-Clamp	NO.		01					
14	11 KV pin Insulator Complete	NO.		03					
15	11 KV Disc Insulator	NO.		06					
16	11 KV Disc fitting	NO.		06					
17	Earthing Rod	NO.		03					
18	Earthing wire 6 SWG	KG.		15					
19	Stay wire 10 SWG	KG.		05					
20	L.T. Insulator	NO.		—					
21	L.T. Clamp	NO.		—					
22									
23									
24									
25									

NAME OF ESTIMATE
 DIV. NAME EDD-1 BLY. E.E.
 NAME OF CONSUMER S.D.O.
 SUB DIVISION AONLA BLY.
 J.E.
 SIG. & SEAL SIG. & SEAL SIG. & SEAL