

Line Chart


Application No. - 1008367091

Name - Arvind Kumar Yadav S/o Ram Akabai Yadav

Add - Agsaura

Est-r/f - 63 kVA

Distance from LT Line - 25 mtrs.

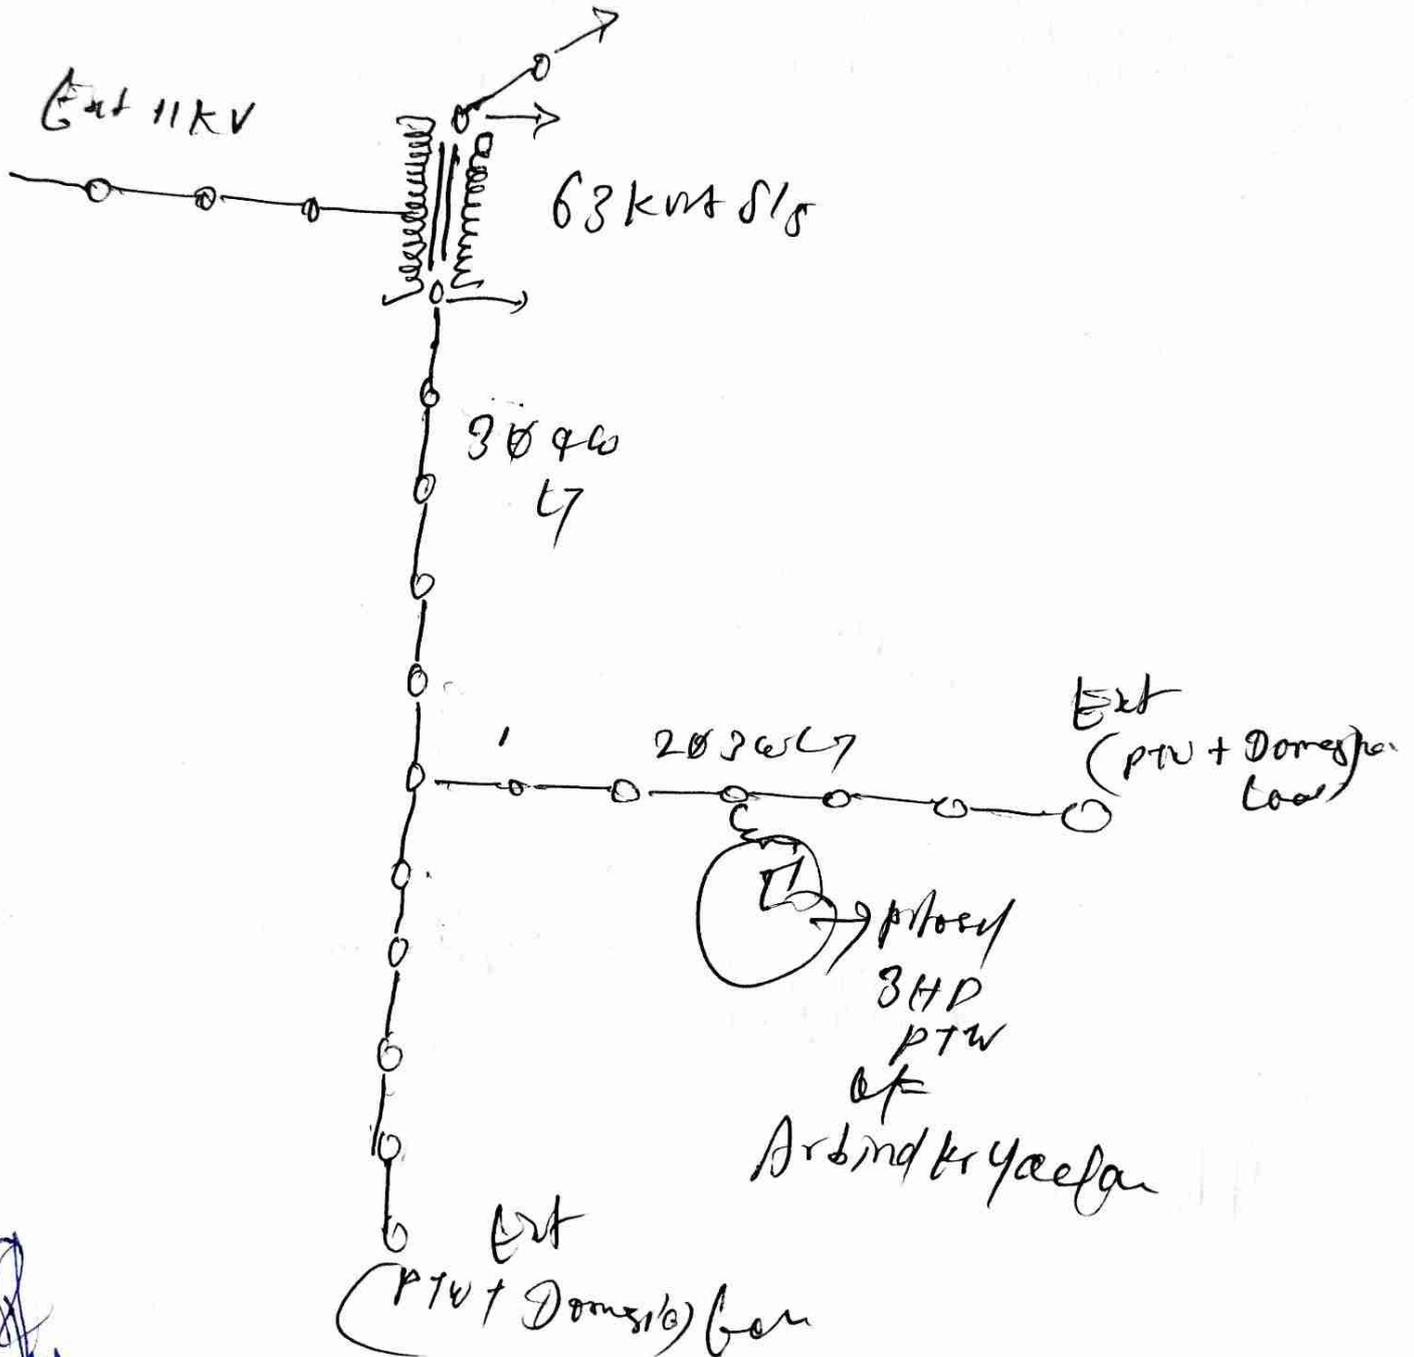


(S D O)


(A H J E)

ELECTRICITY DISTRIBUTION DIVISION

U.P POWER CORPORATION LTD. Jaunpur

Estimate for the year 20 23 20 24

Name of scheme Deposit

Priority No.

Estimate Framed by Sub Divisional Officer Elect. Distri.: Sub Division Jaunpur

For giving supply to Sri Arvind Kumar Yadav

S/o Sri Ram Akabai Yadav of village Agaura

P/o Dhanivan Block Baksha Tahsil Badalapur Distt.-Jaunpur

Load 3 H.P. PTW Process

Head of work involved	Unit Code	Total
Account		
C.E. 955 1. 11 KV Line.....KM.	(a) Rs.	P/K.M Rs.
On P.C.C.....	Support vide Schedule No.....	
C.E. 996 2. L.T. Line 3/2 wire phase.....K.M.	(a) Rs.	P/K. M Rs.
On P.C.C.....	Support vide Schedule No.....	
3. Extra cost for section at D/Pole	(a)Rs.	Rs.
4. Extra for tee of	(a)Rs.	Rs.
5. Extra for underground	(a)Rs.	Rs.
Groassing	vide Schedule No.....	
Extra.....	As per details enclosed Rs.....	
	Total	

C.E 966 (a) 11/4 KV S/S..... Rs.

(b) increasing capacity of existing T/F No.

.....KVA to Cable KVA

Rs.

Vide Schedule No.....

8. Cost of service line as per details type. Rs. 398.00

C.E 976 (a) Fixed Chage Rs. 872.00

(b) Additional Fix Charge Rs. 1270.00

(i) System Loading Charge@

Rs. per KVA for.....

(ii) Variable Chage for PVC

Cable 4x162mmMeter@.....Per mrter

The H.T. Line would be tapped from 11KV Nandwana Feeder in village Agaura

Emanating from 33/11 K.V. S/S Badalapur (Certified that the costing to the work envolved has been done

according to standard schedules framed by RESPO, Lucknow, rates (Line chart on over leaf).

(RAM)
Junior Engineer

Allocation Checked By

Checked by

([Signature])
[Sub Divisional Officer]

Sanctioned For Rs.

And registered at Serial No.....

For the year 20.....20.....

D/Man/Computer

[D.V.W.]

(.....)

Executive Engineer

Electricity Distribution Division