



विद्युत वितरण उपखण्ड
सदर / रानीगंज, प्रतापगढ़ |

पत्रांक- 105

वि०वि०ख०रा०प्रता० /

दिनांक- 05.03.2024

विषय-SIT / TFR रिपोर्ट के सम्बन्ध में।

अधिकासी अभियन्ता

उपरोक्त विषयक आपको अवगत कराना है कि प्रार्थी SANT. DR. PATEL..... SIO JALANMOTI...
ग्राम PATLABPUR AURISTA पोस्ट PATLABPUR..... ब्लाक A.B.N.D..... तहसील
AURISTA

प्रतापगढ़ ने 03..... हाँस पावर निजी नलकूप के संयोजन हेतु रसीद संख्या
रु० 100.00 से प्रोसेसिंग शुल्क जमा किया है। उक्त उपभोक्ता के लोड स्वीकृत करने हेतु निम्नलिखित बिन्दुओं पर
अविलम्ब (SIT / TFR) रिपोर्ट प्रेषित करने का कष्ट करें :-

1- आवेदित परिसर पर पूर्व में बकाये की स्थिति -	नहीं
2- बकाये की स्थिति में संयोजन का पूर्ण विवरण -	नहीं
3- परिसर की निकटतम एच०टी०/ एल०टी० मेन्स से न्यूनतम दूरी -	H.T. 35m
4- वितरण परिवर्तक के अधिभारित की स्थिति -	नहीं प्रस्तावित 41m लोड
5- 1 के०वी० पोषक के अधिभारित की स्थिति -	OK
6 33 / 11 के०वी० उपकेन्द्र के पावर परिवर्तक की स्थिति -	OK
7- मीटर स्थापन हेतु परिसर पर उपलब्ध स्थान की स्थिति -	नहीं है
8- परिसर पर संयोजन का प्रयोग वाणिज्यिक / आवासीय / औद्योगिक / अन्य -	नहीं
9- अन्य तकनीकी आख्या -	संख्या 1021 है।

अदर अभियन्ता

उपखण्ड अधिकारी

पत्रांक -

वि०वि०ख०रा०प्रता० /

दिनांक-

प्रतिलिपि: निम्नलिखित को सूचनार्थ एवं आवश्यक कार्यवाही हेतु प्रेषित :-

1. अधीक्षण अभियन्ता विद्युत वितरण मण्डल प्रतापगढ़।

2. अधिकासी अभियन्ता विद्युत वितरण खण्ड रानीगंज प्रतापगढ़।

3. प्रार्थी S/O ग्राम

पोस्ट ब्लाक तहसील प्रतापगढ़

उपखण्ड अधिकारी

OM. NC

P. NO.....

Electricity Distribution Division, Raniganj Pratapgarh

ESTIMATE

Estimate framed by S.D.O I,II,III,IV..... for supply to Shri SANT. BR. PATEL.....

Village PATILPUR AVALSTA Post PATILPUR AVALSTA Block B.B.N.D S/O JALANNATH

PRATAPGARH
Works Involved

LOAD - 03 HP


Works Involved	Unit Cost	Total
1- 11 KV line <u>0.0025</u> KM	@ Rs <u>236</u> P/KM	Rs. <u>8260 -</u>
On supports	Vide Schedule No.	
2- L.T line 3phase KM	@Rs. P/KM	Rs.
On supports	Vide Schedule No.	
3- Extra cost for Section poles	Rs.	Rs.
4- Extra cost for tree off	Vide Schedule No.	Rs.
5- Extra cost for underground cossing	Rs.	Rs.
6- Extra for	Vide Schedule No.	Rs.
As per Details enclosed	Rs.	Rs.
Total Rs.		8260 -

Length of line chargeable to the Board Meters
 Length of line chargeable to the con Meters 10KVA TIF 47798 -
 Summers beyond free limit Total Meters

7- (a) 1/4 KV Sub Station	Rs.	Rs.
(b) Increasing capacity from	Vide Schedule No.	Rs.
..... KVA to KVA	Rs.	Rs.
8- Cost of Service Line as par details enclosed	Vide Schedule No.	Rs.
(a) Meter Cost	Rs.	Rs. <u>872 -</u>
(b) System Loading Charges	Rs.	Rs. <u>488 -</u>
(c) Fixed Charges	Rs.	Rs. <u>900 -</u>
(d) Security Charges	Rs.	Rs.
Rs.	Rs.	Rs.
Grand Total Rs.		58298

The H.T/L.T line would be tapped from RAKHANA feeder sub-station in Village PATILPUR AVALSTA emanating from 132/33/11 KV Sub-station at SOYANI

Certified that the costing of the works involved has been done according to Standard schedules framed in the Division on current stock issue rates.
 Line chart on this back

Junior Engineer
 Checked by 

Allocation Checked


 Sub-Divisional Officer
 Estimate Sanctioned
 No.

D/Man/Tech.Asstt
.....


Divisional Accountant (Works)

Executive Engineer

No. /of date

- Copy
- 1- Sub-Division Officer
 - 2- Divisional Accountant(W)
 - 3- Assistant Engineer (Store)

LINE CHART

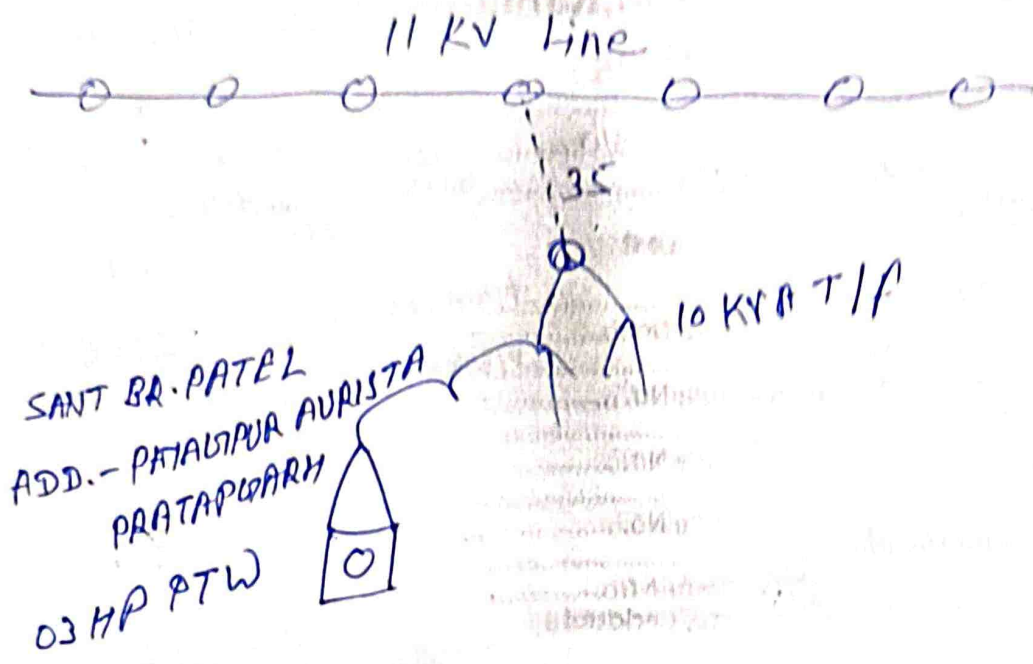

Requirement

- 1- P.C.C. Pole 8.5 mtr..... No
- 2- ACSR Vaseline Conductormtr
- 3- GI wire SWGKG
- 4- Stay RodNo
- 5- Stay wire 7/10 swgKG
- 6- Earthing RodNo
- 7- T/F KVANo
- 8- Length of Linemtr

Voltage Drop Calculation

[Signature]
SDO

[Signature]
Jr. Engineer